


MEDIUM VOLTAGE AMP-TRAP FUSE  
MINIMUM MELTING TIME CURRENT DATA  
BOLT IN 5.5KV  
CAT. NO. A055B3D0R0-(750E-900E)  
A055B3DBR0-(750E-900E)  
FERRAZ SHAWMUT  
NEWBURYPORT, MA 01950

24445

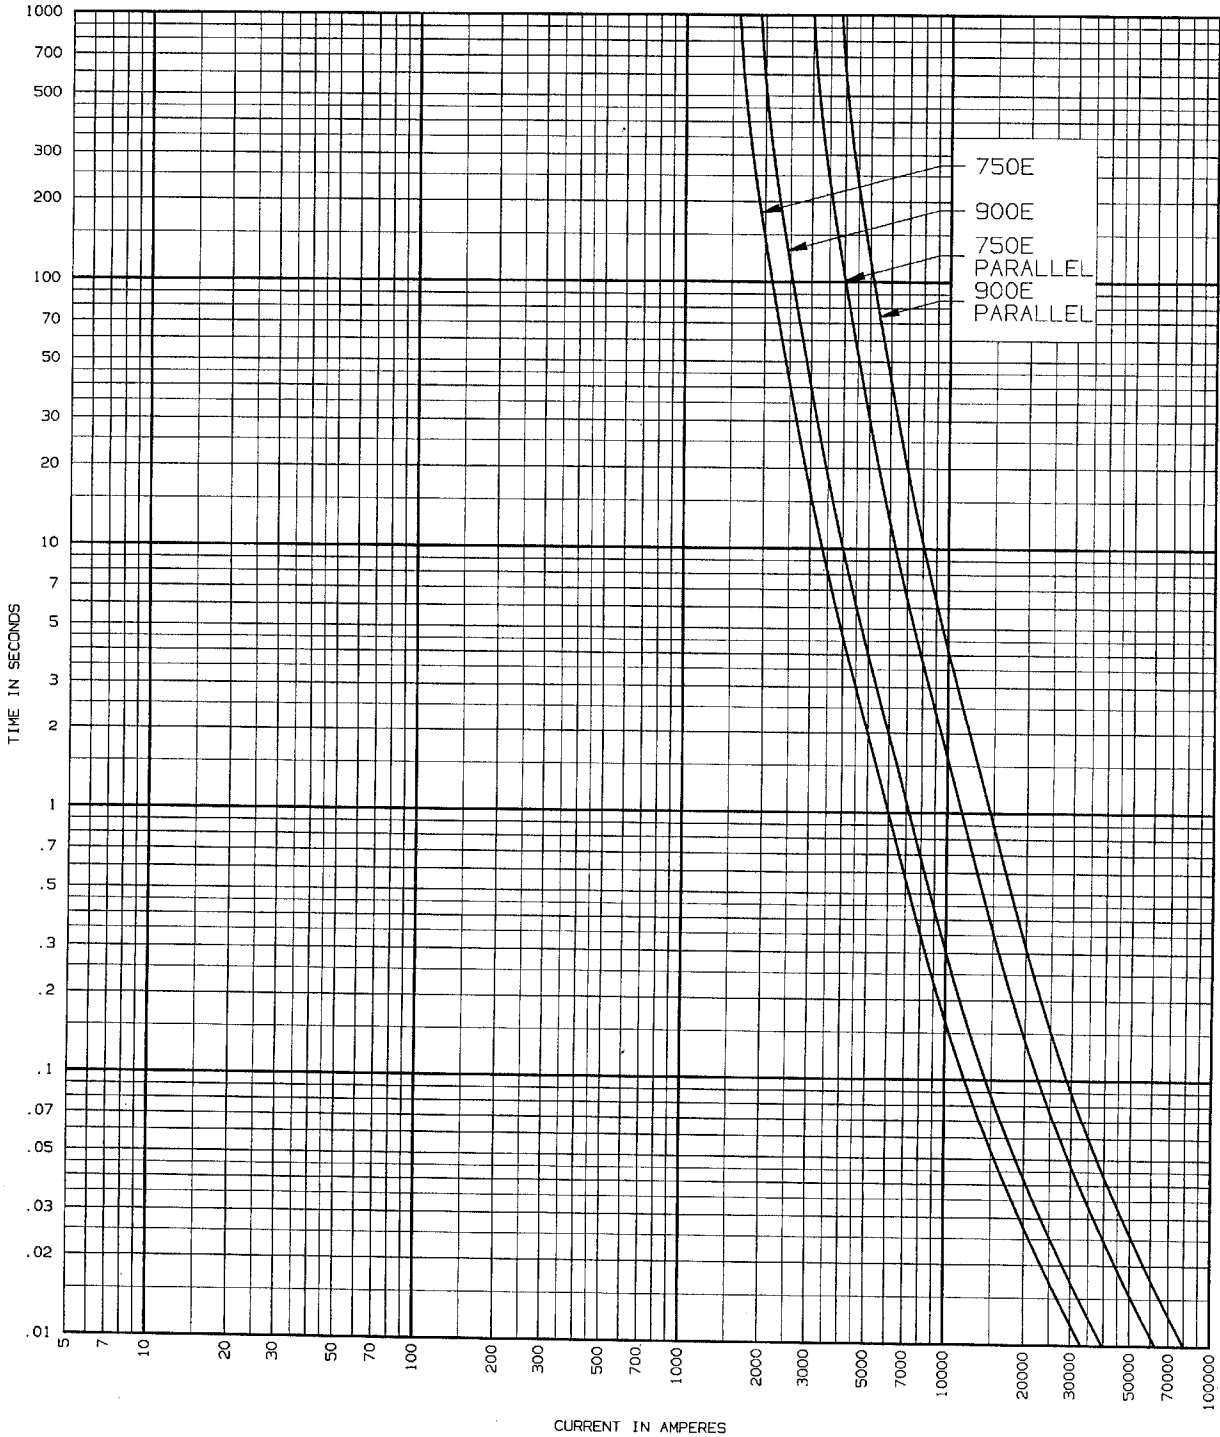

CONTROL NO: 729  
FOLDER NO. 5B  
REV. A  
2/10/05